


Three-Compartment Sink

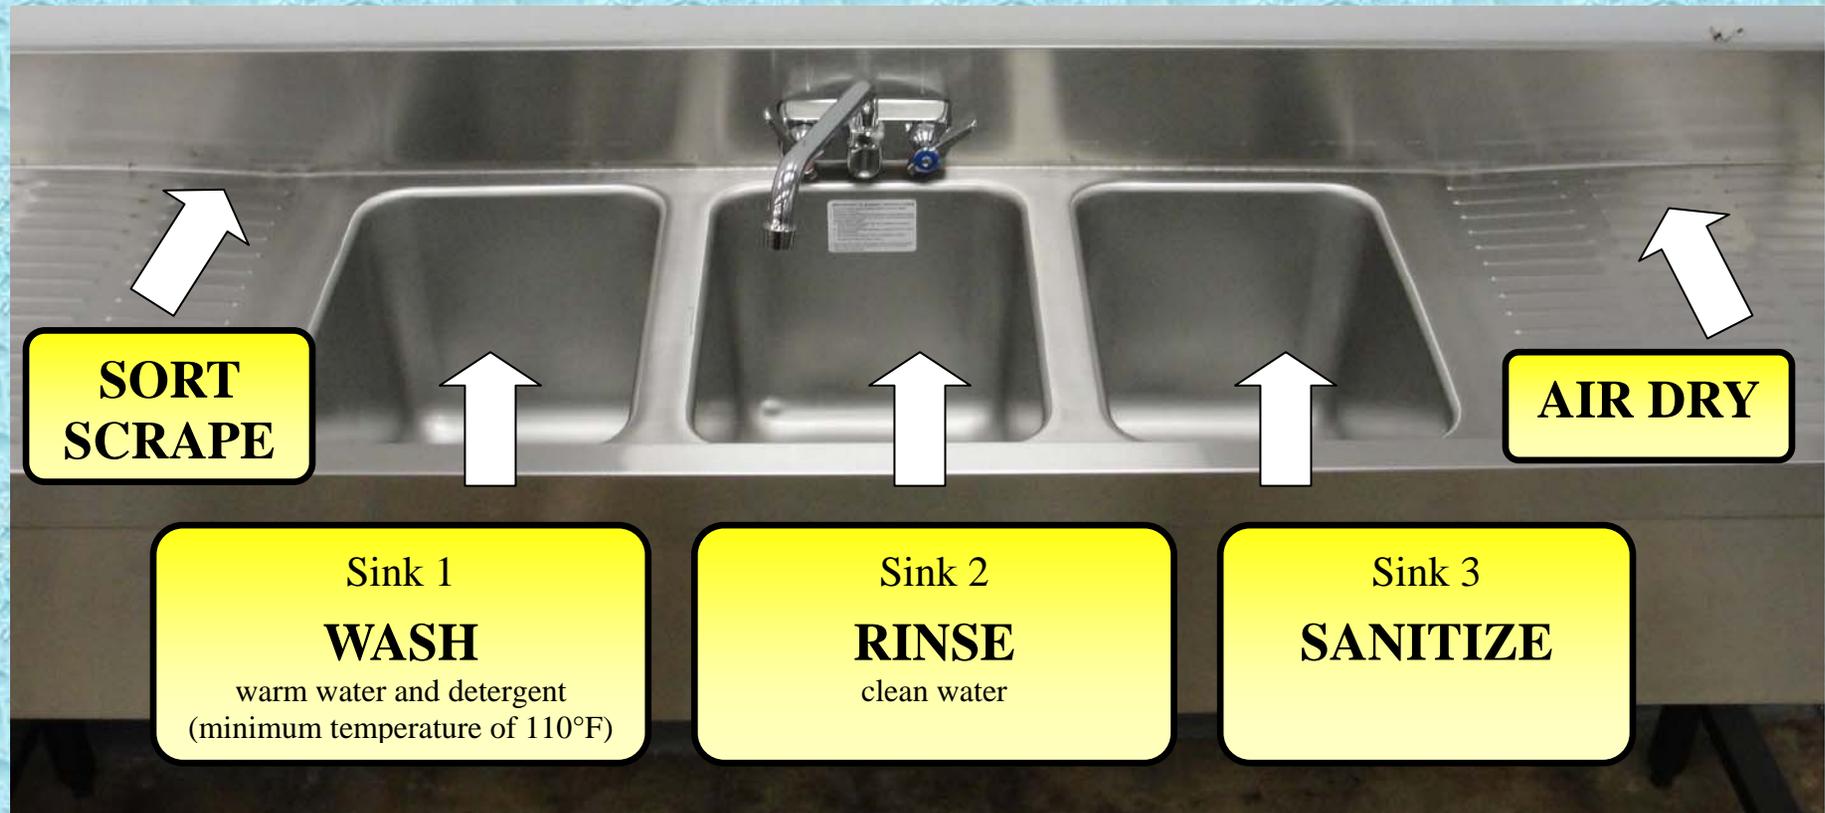

HOW TO SANITIZE

Chlorine Solution

- minimum temperature 75°F - 100°F
- 7-10 seconds in 25 - 100 ppm

Quaternary Ammonium Solution

- minimum temperature 75°F
- 30 seconds in 200 – 400 ppm

Iodine Solution

- minimum temperature 75°F
- 30 seconds in 12.5 - 25 ppm

*All chemical solutions should be tested for effectiveness using a test kit strip.
Use according to manufacturers directions and the Texas Food Establishment Rules*